
TECHNICAL CATALOGUE

PCS100 AVC-40

Active Voltage Conditioner for sag correction



ABB Power Conditioning

Leading the industry in innovation and technology, ABB provides power conditioning for many of the world's foremost organizations, ensuring the continuous operation of small, medium to large businesses are protected on a global scale.

ABB's Power Conditioning portfolio is a unique line up of low and medium voltage power conversion technology that is part of the product group, Power Protection.

The portfolio consists of static frequency converters, UPSs, voltage and power conditioners

that demonstrate highly reliable and cost-effective performance. With this product portfolio, ABB offer efficient power conditioning solutions that are specifically designed to solve power quality problems and stabilize networks.

Covering applications from data centers through to complete industrial plant protection, micro grid systems and shore-to-ship supply, ABB have the power conversion technology for every need. Starting from a few kVA to many MVA and a wide range of supply voltages.

It's business as usual with power conditioning technologies in place.

Power Conditioning Product Portfolio

| Product Line | Typical Problems | Product |
|----------------------|--|---|
| Industrial UPS | Utility deep sag and surge correction | PCS100 UPS-I Industrial UPS |
| | Utility outage protection | PCS120 MV UPS Medium Voltage UPS |
| Voltage conditioning | Utility sag and surge correction | PCS100 AVC-40 Active Voltage Conditioner for sag correction |
| | Load voltage regulation | PCS100 AVC-20 Active Voltage Conditioner for voltage regulation |
| Frequency Conversion | 50/60 Hz conversion Frequency fluctuation | PCS100 SFC Static Frequency Converter |




Contents

| | |
|--|----|
| Voltage Sags – The Problem..... | 1 |
| PCS100 AVC-40 Active Voltage Conditioner | 2 |
| PCS100 AVC-40 Benefits..... | 3 |
| Industries and Applications | 4 |
| Features..... | 5 |
| Functional Description..... | 6 |
| Technical Specification | 8 |
| How to Select a PCS100 AVC-40..... | 10 |
| PCS100 AVC-40 Model Range | 11 |
| Layout Plans and Dimensions | 12 |
| Options | 16 |
| User Interface | 19 |
| User Connections..... | 21 |
| Installation Requirements | 22 |
| Notes..... | 26 |

Voltage Sags – The Problem

Modern industries are becoming more automated and the sensitivity of processes to power quality events is increasing. Although utilities endeavor to supply reliable, high-quality power, voltage sags and surges will continue to be a fact of life, even with modern power networks. Even a short event of less than one cycle can cause processes to unexpectedly stop, potentially resulting in product damage, wastage and production shortages.

A voltage sag is not a complete interruption of power; it is a temporary drop below 90 percent of the nominal voltage level. Most voltage sags do not go below 50 percent of the nominal voltage, and they normally last from 2 to 10 cycles - or from 32 to 200 milliseconds.

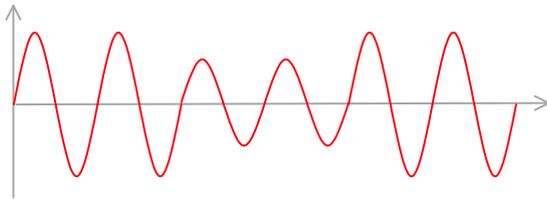

There are two sources of voltage sags: external, on the utility's transmission and distribution lines, and internal within the customer's facility.

Utilities continuously strive to provide the most reliable and consistent electric power possible. In the course of normal utility operations, however, many things can cause voltage sags.

Weather is the most common cause of external sags and momentary interruptions all around the world.

Thunderstorms and lightning strikes on power lines create line to ground faults causing voltage sags in a wide area.



High winds can blow tree branches into power lines, connecting the line with the ground and shorting between phases. A series of sags will occur as the branches repeatedly touch the power lines.

Snow and ice buildup on power lines can cause flash overs on the insulators.



Other external causes are traffic accidents, construction works and animals impacting the power lines.


Internal causes of voltage sags can include starting major loads and grounding or wiring problems.

Whether or not a voltage sag causes a problem will depend on the magnitude and duration of the sag and on the sensitivity of your equipment. Many types of electronic equipment are sensitive to voltage sags, including variable speed drive controls, motor starter contactors, robotics, programmable logic controllers, controller power supplies, and control relays. Much of this equipment is used in applications that are critical to an overall process, which can lead to very expensive downtime when voltage sags occur.

PCS100 AVC-40 Active Voltage Conditioner

The ABB PCS100 AVC-40 is an inverter based system that protects sensitive industrial and commercial loads from voltage disturbances.

Providing fast, accurate voltage sag and surge correction as well as continuous voltage regulation and load voltage compensation. The PCS100 AVC-40 has been optimally designed to provide equipment immunity from power quality events on the supply network.

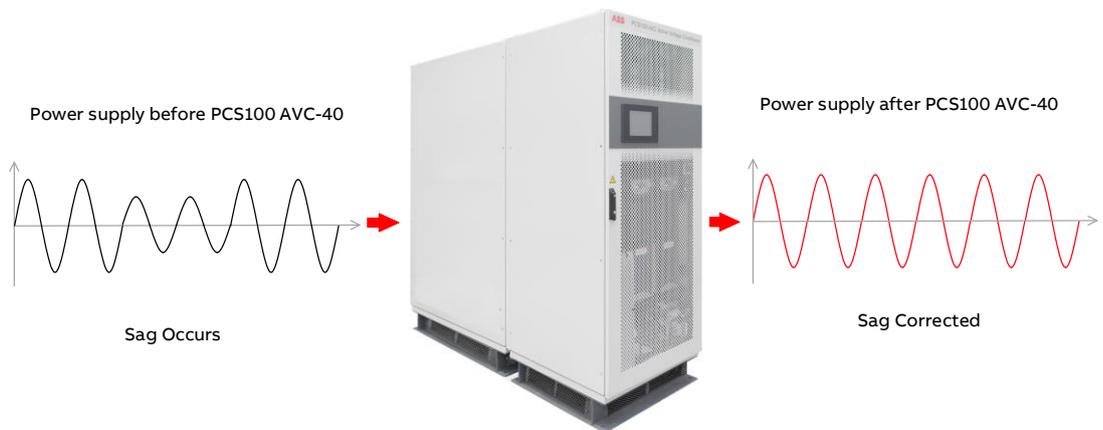


How it works

The PCS100 AVC-40 consists of two converters that are not on the current path between the load and the utility. Instead, the corrective voltage injection is achieved by means of a transformer winding between the utility and the sensitive load. This configuration results in a very efficient and effective method to provide voltage correction with reduced risk of negative impacts on the load.

The PCS100 AVC-40 requires no batteries as it draws the additional energy required during sag to make up the correction voltage from the utility supply. With no ongoing maintenance costs typically associated with batteries the cost of ownership for PCS100 AVC-40 systems is very small.

Furthermore, the PCS100 AVC-40 contains a redundant internal bypass system that, in the event of overload or internal fault condition, ensures that the load is continued to be supplied from the utility.

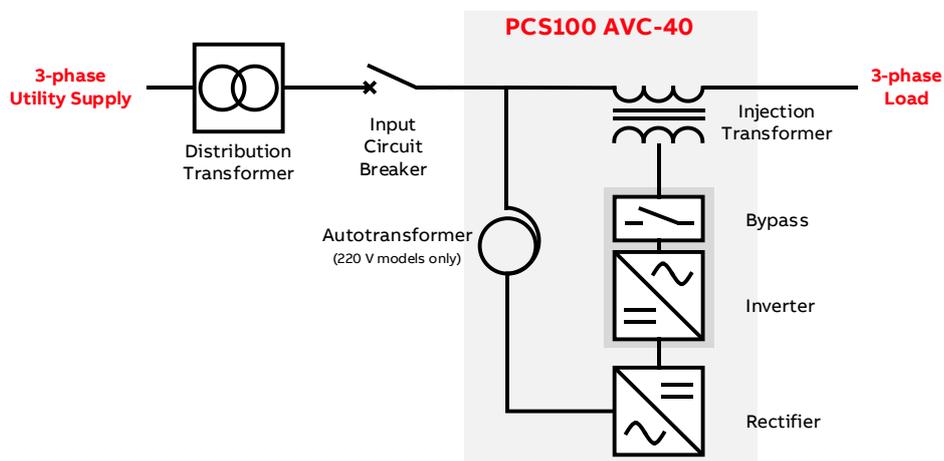

PCS100 AVC-40 Benefits



Reduce the cost of sag events

The PCS100 AVC-40 closes the electrical compatibility gap between the supply and plant by protecting the load from utility induced voltage sag events. The PCS100 AVC-40 minimizes the undue stress to the expensive equipment, thus increasing the equipment lifetime.

With high power capacity, the PCS100 AVC-40 is a perfect solution for industrial loads using significant power as well as large commercial buildings where continuity of service is paramount. The PCS100 AVC-40 is designed to target voltage sag events while also providing protection against swells. Sag events is the major cause of lost production.

Improve plant operation

The PCS100 AVC-40 regulates the voltage, removing long term undervoltage, overvoltage and voltage imbalance to reduce waste and damage to the expensive equipment. It also removes voltage fluctuations, which can cause process variation, improving the quality of operation of the plant or the facility.

Faster return on investment

With industry leading efficiency exceeding 98 percent the PCS100 AVC-40 requires minimal costs for electricity and cooling. With no energy storage the ongoing maintenance cost is minimized, resulting low total cost of ownership.

Reduce damage to equipment

Protect expensive equipment by regulating the voltage to remove long term undervoltage, overvoltage and voltage imbalance.

Industries and Applications

Industrial automation has reached very high levels of sophistication. Industrial plants and commercial equipment now use advanced technology, and this technology relies on a robust and continuous power supply. However, the utility grid is susceptible to unpredictable events, such as lightning strikes and faults, resulting in voltage sags.

In the modern industrial world voltage sags cause disturbances in process and product defects. This results in wasted material, long restart times,

extensive repair or maintenance activities, revenue losses or contractual penalties.

The costs of such events can quickly amount to hundreds of thousands of dollars.

Nowadays, almost all continuous production lines and process industries or sensitive medical equipment must perform faultlessly on a continuous basis. Ensuring that equipment receives a stable, clean, continuous flow of power, even during major grid disturbances, is where the PCS100 AVC-40 comes in.

PCS100 AVC-40 provides power protection of commercial and industrial loads

Electronics industry
Sensitive machinery
Clean room control



Food and beverage
High speed bottling
Packaging lines
Dairy processing



Automotive
Welding process
Coating process
Painting process



Continuous process
Fiber production lines
Film production lines
Extrusion process



Pharmaceutical
Batch process
Climate control



Medical
Sensitive medical imaging equipment



Features



No energy storage

Increased system reliability with minimized maintenance

Very high efficiency

Typically >98% even on partial loading

Continuous online regulation

Continuous regulation within $\pm 10\%$ with response less than 250 μs and correction in less than $\frac{1}{2}$ cycle

Industrial design

Rugged overload capability, industrial grade fault capacity, designed for industrial loads

Small footprint

Industry leading power density

Regenerative load support

Bidirectional power module design allows connection of regenerative loads such as lifts and cranes

Internal bypass

Redundant internal bypass design guaranteeing continuity of load supply in case of PCS100 AVC-40 fault

Connectivity

Ethernet
Modbus TCP
Integrated web server
E-mail notifications

Modular construction

Proven PCS100 power converter platform, with more than 1800 MVA installed base, enabling fast and easy maintenance

Sophisticated control software

Based on 20 years voltage conditioning industry experience

Multilingual graphical touch screen interface

Simple user controls, easy to understand event log and voltage event data logging

Functional Description

PCS100 AVC-40 Correction Capabilities


The PCS100 AVC-40 responds to voltage sags or swells within several milliseconds and can inject up to 40 percent voltage correction. If a facility was faced with a voltage sag to 60 percent of nominal voltage the PCS100 AVC-40 would boost the voltage back to 100 percent. Voltage sags with 50 per-cent of nominal voltage are corrected back to 90 percent. No process interruption, no equipment would trip, just business as usual.

Performance is even better for single phase sags (the most common type), voltage sags down to 40 percent of the nominal voltage are fully corrected.

In case of deeper voltage sags, The PCS100 AVC-40 provides a partial correction, which will often prevent loads tripping. In addition, it can continuously correct voltage fluctuations of ± 10 percent of nominal, and remove imbalances.


| Utility Supply Problem | Input | Output | Correction Time |
|---|------------------------------|--------|------------------|
| Three-phase utility sags correction from | 60% remaining supply voltage | 100% | 30 seconds |
| | 50% remaining supply voltage | 90% | 10 seconds |
| | 40% remaining supply voltage | 70% | 600 milliseconds |
| Single-phase utility sags correction from | 40% remaining voltage | 100% | 30 seconds |
| | 0% remaining voltage | 57% | 600 milliseconds |
| Single-phase utility swells correction from 115% voltage | | 100% | Continuous |
| Three-phase utility undervoltages to 90% of the nominal supply voltage | | 100% | Continuous |
| Three-phase utility overvoltages up to 110% of the nominal supply voltage | | 100% | Continuous |
| Correction of phase angle errors created by faults in the supply system | | Yes | |
| Correction of voltage imbalance from utility supply | | Yes | |
| Attenuation of flicker voltages in the utility supply | | Yes | |

PCS100 AVC-40 Performance Curve

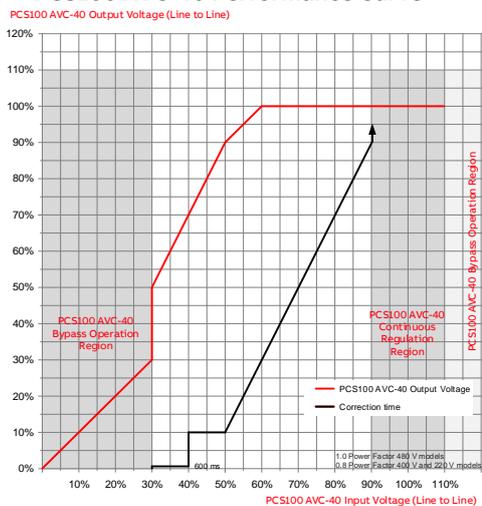

Three Phase Balanced Events

The performance curves on the left apply to three phase balanced supply voltage disturbances upstream of the PCS100 AVC-40.

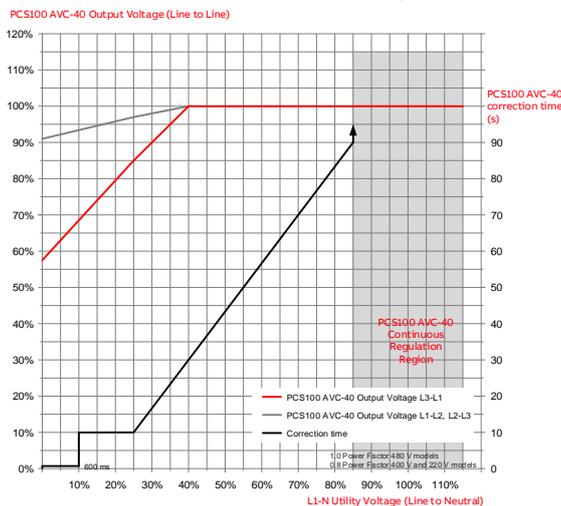

Single-Line-To-Ground Events



The performance curves on the left apply to single-line-to-ground supply voltage disturbances upstream of the Dyn11 distribution transformer upstream of PCS100 AVC-40.

Operational Detail

The following diagrams show the PCS100 AVC-40 operation when a utility disturbance occurs, and operation of the internal bypass.


Utility Voltage Close to Nominal Level

When the utility voltage is close to nominal level, i.e. typical utility supply conditions without sags or surges, the PCS100 AVC-40 is only adding small corrections for utility voltage unbalance or load induced voltage variations.

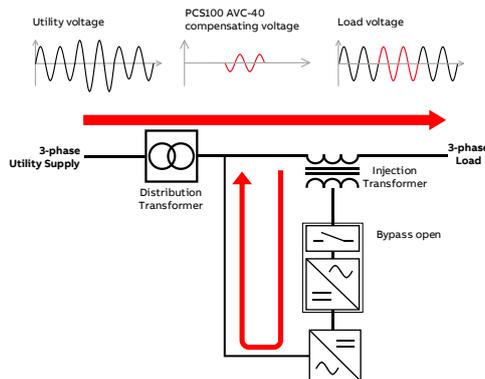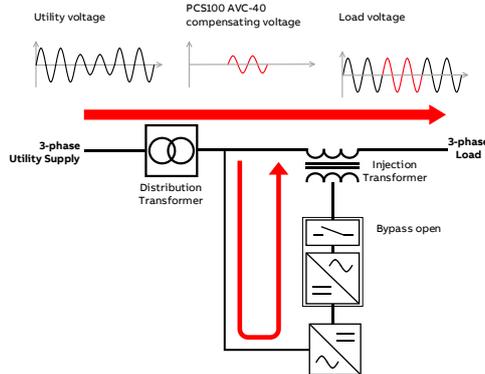

Internal Bypass Operation


In the case of an overload or internal fault condition the internal bypass circuit will shunt the inverter side of the Injection Transformer, bypassing the inverter and effectively providing a direct connection from the utility supply to the output, without interruption to the load.

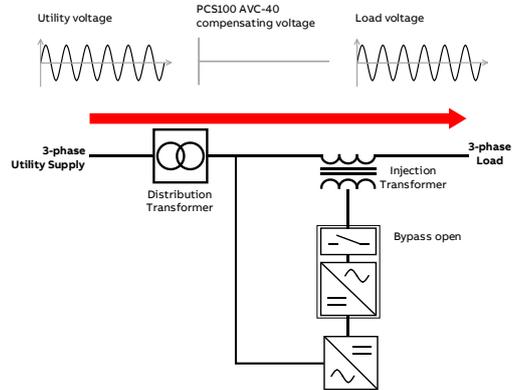

Utility Disturbance Occurs

When the utility voltage deviates from nominal or the set point due to a power quality event, the inverter will inject a correcting voltage via the Injection Transformer. The correcting voltage level is based on the disturbance level and the energy needed for correction is sourced from the utility via the PCS100 AVC-40 rectifier.

Diagrams on the left show cases with utility voltage below and above nominal level.

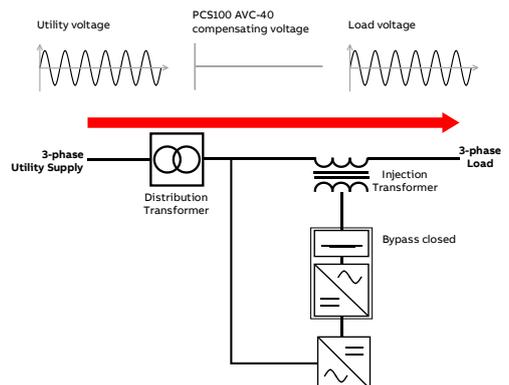

Technical Specification

| Utility - Input | |
|---|---|
| Power range | 150 – 1800 kVA (220 V model) 150 – 3600 kVA (400 and 480 V model) |
| Rated voltage (model specific) | 220 V – application range 208 – 220 V 400 V – application range 380 – 415 V 480 V – application range 440 – 480 V |
| Maximum supply voltage | 110% |
| Nominal supply frequency | 50 or 60 Hz |
| Frequency tolerance | ± 5 Hz |
| Power system | 3 phase + Neutral (4-Wire) ¹ Center ground referenced (TN-S) |
| Overvoltage category | III |
| Fault capacity | Refer to the model tables shown in this document |
| Outage – control ride through | 600 ms |
| Harmonics ² | IEC 61000-2-4 Class 2 (THDv < 8%) |
| Load - Output | |
| Voltage | To match nominal input voltage ³ |
| Equivalent series impedance | < 4% (model specific) |
| Displacement power factor | 0 lagging to 0.9 leading ⁴ |
| Crest factor | 3.0 |
| Overload capability from 100% supply voltage | 150% for 30 s, once every 500 s |
| Performance | |
| Efficiency | Typically > 98% |
| Sag correction response | Initial < 250 μs Complete < ½ cycle |
| Voltage regulation accuracy | ±1% typical, ±2% max. |
| Sag correction accuracy | ±4% |
| Continuous regulation range | ±10% |
| Sag correction performance ⁵ | |
| Three phase sags | 60% to 100% for 30 s, 50% to 90% for 10 s |
| Single phase | 40% to 100% for 30 s |
| Partial correction derating conditions ⁶ | 1.0 PF at 80% load 0.8 PF at 100% load |
| Internal Bypass | |
| Capacity | 100% of model rating (kVA) 125% for 10 minutes |
| Maximum overload capacity (in bypass) | 150% for 1 minute 500% for 1 s 2000% for 200 ms |
| Transfer time | To Bypass < 0.5 ms To Inverter < 250 ms |
| Equivalent series impedance | bypass < 2.5% typical |
| Injection Transformer | |
| Transformer type | Dry |
| Insulation | IEC 60085 Thermal class 200 |
| Frequency | 50 Hz and 60 Hz |
| Vector group | Diii (delta + 3 independent windings) |

¹ Neutral provided by supply transformer if required by the load

² For THDv > 8%, please refer to factory. For applications where THDv is above 10% lifetime of components may be significantly affected, please refer to factory.

³ Output voltage can be adjusted by ±10% with 0.1% steps

⁴ Consult the factory if there is a power factor correction unit downstream

⁵ Refer to performance curves in this document for more details

⁶ Refer to document 2UCD070000E020 PCS100 AVC Detailed Performance Curves

| Environmental | |
|-------------------------------------|--|
| Operating temperature range | 0° C to 50° C (32° F to 122° F) |
| Temperature derating | Above 40° C, derate at 2% load per °C to a maximum of 50° C |
| Operating altitude | < 1000 m without derating |
| Capacity derating with altitude | 1% every 100 m above 1000 m 2000 m maximum |
| Inverter cooling | Forced ventilation |
| Transformer cooling | Natural convection |
| Humidity | < 95%, non-condensing |
| Pollution degree rating | 2 |
| Noise | < 75dBA @ 2 m |
| Enclosure | |
| Enclosure rating | IP20 |
| Material | Electro-galvanized steel |
| Panel thickness | |
| Side and rear | 1.5 mm |
| Door | 2 mm |
| Finish | Standard epoxy-polyester powder coating textured finish |
| Color | RAL7035 |
| Enclosure access | Hinged doors with key lock |
| Service | |
| MTTR | 30 min typical by module exchange |
| Diagnostics | Non-volatile event & service log |
| Remote monitoring | E-mail |
| User Interface | |
| User interface | 10.1" color touch panel, multilingual |
| Touch panel | Full parameter control, system event log, voltage event log |
| Control inputs | Start / Stop / Reset digital inputs |
| Control outputs | Run, warning and fault relays |
| Communication | Ethernet Modbus TCP E-mail |
| Power Quality Event Monitor | |
| Events recorded | Voltage Sag (RMS) Voltage Surge (RMS) |
| Measurement type | Half-cycle RMS according to IEC 61000-4-30 |
| Event detection | Input Voltage |
| Sag threshold | 90% of Utility voltage default setting (user adjustable) |
| Surge threshold | 110% of Utility voltage default setting (user adjustable) |
| Accuracy | Voltage: ±2% Duration: 10 ms |
| Remote monitoring | E-mail notification |
| Standards and Certifications | |
| Quality | ISO 9001 |
| Environmental | ISO 14001 |
| Marking | CE, C-Tick |
| Safety | IEC 62103 |
| Electromagnetic compatibility | Emissions: CISPR 11 Class A Group 1 Immunity: IEC 61000-6-2 |
| Performance | IEC 61000-4-34 |

How to Select a PCS100 AVC-40

To select the correct size of the PCS100 AVC-40 for the application the following information should be known.


- Utility voltage
- Power rating of the load (kVA and kW, or kVA and power factor)

The product tables in the following section can then be used to look up the required model for the given application. Each model has a specific type code.

Type Code

The PCS100 AVC-40 type code is given in the product tables. The type code is a unique code for the specific PCS100 AVC-40 model and specifies all the components that are used to construct the model. From the base code given in the product tables options can be added to the type code. These options are called plus (+) codes.

The following diagram outlines the structure of the type code:

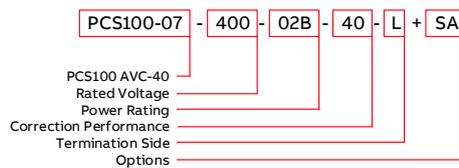

Type Code Parameters:

Rated Voltage

This is the rated voltage of the PCS100 AVC-40. Options are 480 V, 400 V and 220 V. Other operating voltages (e.g. 380V) are achieved by software settings and setting of an auxiliary transformer tapping.

Power Rating

Rated power of the system is based on the number of power module pairs. Each power module pair operating on rated voltage provides 300 kVA of power⁷.

Correction Performance

Defines sag correction performance. Correction performance of the PCS100 AVC-40 is 40%.

Termination Side


The location of the power terminals (input and output) when viewed from the front of the Transformer Enclosure⁸.

Options

Options as described in this catalogue are then added as plus codes to the main type code.

PCS100 AVC Sizing Tool

In addition, ABB provides a Windows PC application PCS100 AVC Sizing Tool that can be used to dimension the correct PCS100 AVC-40 model required for the application.

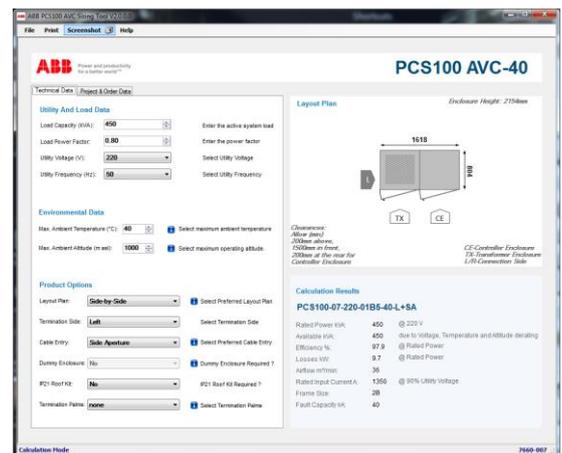

For further information and tool availability please contact your local ABB sales office.

⁷ Operation at lower than the rated voltage results in less kVA per module pair. Consult the rating tables for more information.

⁸ Frame size 1B without additional termination related options termination side can be from left, right or bottom as the transformer terminals are facing front.

PCS100 AVC-40 Model Range

| Rated power kVA | Rated Input Current A ⁹ | Rated Output Current A | Fault Capacity kA | Losses kW ¹⁰ | Efficiency % ¹¹ | Airflow m3/min | Frame Size | Type Code Place R for right termination side or L for left termination side instead of x | |
|---------------------|---|---------------------------------|-------------------------|----------------------------|-------------------------------|-------------------|---------------|--|-------------------------|
| 220 V Models | | | | | | | | | |
| Utility Voltages | | | | | | | | | |
| 220 V | 208 V | | | | | | | | |
| 150 | 142 | 459 | 394 | 31.5 | 5.0 | 96.7 | 18 | 1B | PCS100-07-220-0B5-40-x |
| 225 | 213 | 686 | 591 | 31.5 | 6.5 | 97.2 | 18 | 1B | PCS100-07-220-0B75-40-x |
| 300 | 284 | 905 | 788 | 31.5 | 7.1 | 97.7 | 18 | 1B | PCS100-07-220-01B-40-x |
| 450 | 425 | 1350 | 1181 | 40 | 9.7 | 97.9 | 36 | 2B | PCS100-07-220-01B5-40-x |
| 600 | 567 | 1791 | 1575 | 40 | 11.8 | 98.1 | 36 | 2B | PCS100-07-220-02B-40-x |
| 750 | 709 | 2239 | 1969 | 50 | 14.5 | 98.1 | 54 | 3B | PCS100-07-220-02B5-40-x |
| 900 | 851 | 2679 | 2362 | 50 | 16.4 | 98.2 | 54 | 3B | PCS100-07-220-03B-40-x |
| 1200 | 1135 | 3567 | 3150 | 80 | 20.7 | 98.3 | 72 | 4B | PCS100-07-220-04B-40-x |
| 1500 | 1418 | 4450 | 3937 | 100 | 25.2 | 98.4 | 90 | 5B | PCS100-07-220-05B-40-x |
| 1800 | 1702 | 5331 | 4724 | 100 | 29.1 | 98.4 | 108 | 6B | PCS100-07-220-06B-40-x |
| 400 V Models | | | | | | | | | |
| Utility Voltages | | | | | | | | | |
| 400, 415 V | 380 V | | | | | | | | |
| 150 | 142 | 253 | 217 | 15 | 4.7 | 96.9 | 18 | 1B | PCS100-07-400-0B5-40-x |
| 225 | 213 | 377 | 325 | 15 | 6.1 | 97.3 | 18 | 1B | PCS100-07-400-0B75-40-x |
| 300 | 285 | 498 | 433 | 15 | 6.6 | 97.8 | 18 | 1B | PCS100-07-400-01B-40-x |
| 450 | 427 | 742 | 650 | 31.5 | 8.9 | 98.1 | 36 | 2B | PCS100-07-400-01B5-40-x |
| 600 | 570 | 985 | 867 | 31.5 | 10.8 | 98.2 | 36 | 2B | PCS100-07-400-02B-40-x |
| 750 | 712 | 1232 | 1083 | 31.5 | 13.5 | 98.2 | 54 | 3B | PCS100-07-400-02B5-40-x |
| 900 | 855 | 1474 | 1300 | 31.5 | 15.2 | 98.4 | 54 | 3B | PCS100-07-400-03B-40-x |
| 1200 | 1140 | 1962 | 1733 | 40 | 19.1 | 98.5 | 72 | 4B | PCS100-07-400-04B-40-x |
| 1500 | 1425 | 2448 | 2166 | 50 | 23.3 | 98.5 | 90 | 5B | PCS100-07-400-05B-40-x |
| 1800 | 1710 | 2932 | 2599 | 63 | 26.8 | 98.6 | 108 | 6B | PCS100-07-400-06B-40-x |
| 2400 | 2280 | 3849 | 3465 | 65 | 36.3 | 98.5 | 144 | 8B | PCS100-07-400-08B-40-x |
| 3000 | 2850 | 4920 | 4331 | 65 | 47.7 | 98.4 | 180 | 10B | PCS100-07-400-10B-40-x |
| 3600 | 3420 | 5774 | 5197 | 65 | 60.3 | 98.3 | 216 | 12B | PCS100-07-400-12B-40-x |
| 480 V Models | | | | | | | | | |
| Utility Voltages | | | | | | | | | |
| 480 V | 440 V | | | | | | | | |
| 150 | 138 | 211 | 180 | 20 | 4.7 | 96.9 | 18 | 1B | PCS100-07-480-0B5-40-x |
| 225 | 206 | 315 | 271 | 20 | 6.1 | 97.3 | 18 | 1B | PCS100-07-480-0B75-40-x |
| 300 | 275 | 415 | 361 | 20 | 6.6 | 97.8 | 18 | 1B | PCS100-07-480-01B-40-x |
| 450 | 413 | 619 | 542 | 25 | 8.9 | 98.1 | 36 | 2B | PCS100-07-480-01B5-40-x |
| 600 | 550 | 821 | 722 | 25 | 10.8 | 98.2 | 36 | 2B | PCS100-07-480-02B-40-x |
| 750 | 688 | 1026 | 903 | 25 | 13.5 | 98.2 | 54 | 3B | PCS100-07-480-02B5-40-x |
| 900 | 825 | 1228 | 1083 | 25 | 15.2 | 98.4 | 54 | 3B | PCS100-07-480-03B-40-x |
| 1200 | 1100 | 1635 | 1444 | 40 | 19.1 | 98.5 | 72 | 4B | PCS100-07-480-04B-40-x |
| 1500 | 1375 | 2040 | 1805 | 40 | 23.3 | 98.5 | 90 | 5B | PCS100-07-480-05B-40-x |
| 1800 | 1650 | 2444 | 2166 | 50 | 26.8 | 98.6 | 108 | 6B | PCS100-07-480-06B-40-x |
| 2400 | 2200 | 3290 | 2887 | 65 | 34.1 | 98.6 | 144 | 8B | PCS100-07-480-08B-40-x |
| 3000 | 2750 | 4110 | 3609 | 65 | 44.3 | 98.5 | 180 | 10B | PCS100-07-480-10B-40-x |
| 3600 | 3300 | 4940 | 4331 | 65 | 55.4 | 98.5 | 216 | 12B | PCS100-07-480-12B-40-x |

⁹ At 90% utility voltage

¹⁰ Typical value

¹¹ Typical value



Layout Plans and Dimensions

Side-by-side Layout Plans



The following plans relate to the standard Side-by-Side Layout of all frame sizes. Shown layouts are only for right (R) termination side. For left (L)

termination side in Side-by-Side layout, the Transformer Enclosure is mounted on left side of Controller Enclosure.



1B frame size¹²

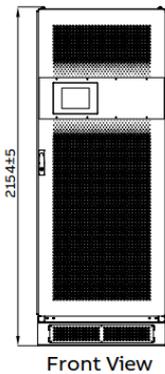



2B frame size¹³ Right termination side

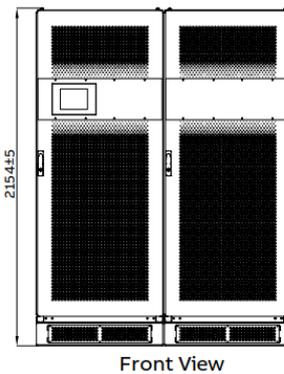

3B frame size¹³ Right termination side

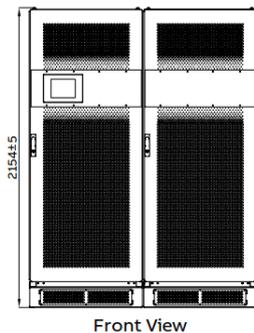

4B, 5B and 6B frame size Right termination side

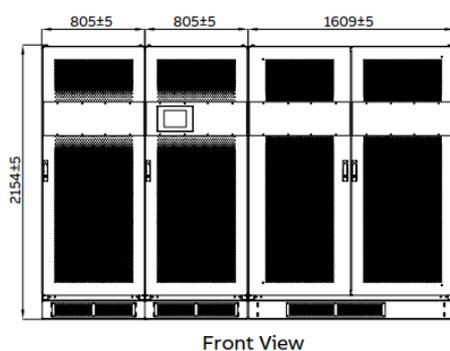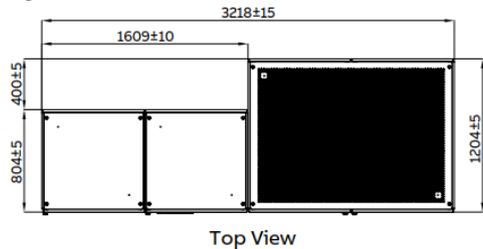


¹² In frame size 1B without optional Termination Enclosure, Cable Ducts or Side Aperture termination side can be from left, right or bottom as the Injection Transformer terminals (customer's connection terminals) are facing front.

¹³ For frame sizes 2B and 3B, due to position of Injection Transformer terminals, optional Termination Enclosure or Side Aperture MUST be selected. Please see Options chapter of this document for option description.


Back-to-back Layout Plans

The following plans relate to the optional Back-to-Back layout with left (L) or right (R) termination side options shown. Exact termination side needs to be defined with L or R in the product type code.

2B frame size¹⁴




Top View

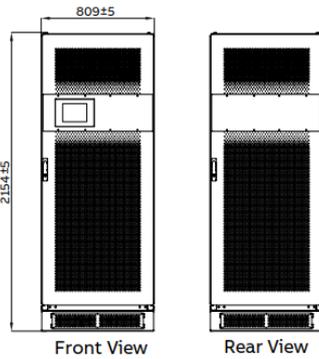


Front View

Rear View

3B frame size¹⁴




Top View

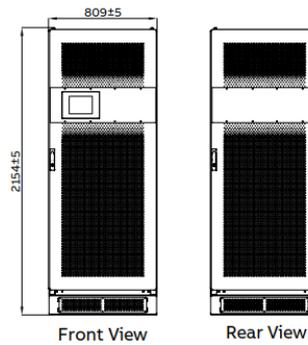


Front View

Rear View

4B, 5B and 6B frame size

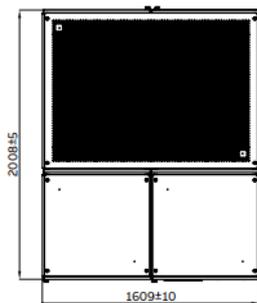

Top View

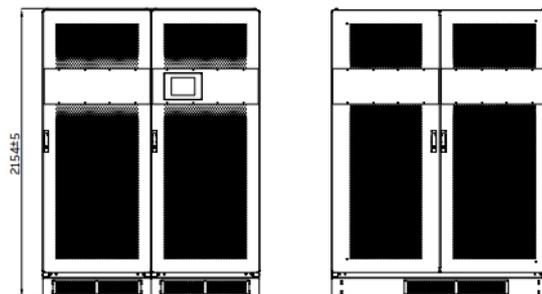


Front View

Rear View

¹⁴ For frame sizes 2B and 3B, due to position of Injection Transformer terminals, optional Termination Enclosure or Side Aperture MUST be selected. Please see Options chapter of this document for option description.


8B, 10B and 12B frame size

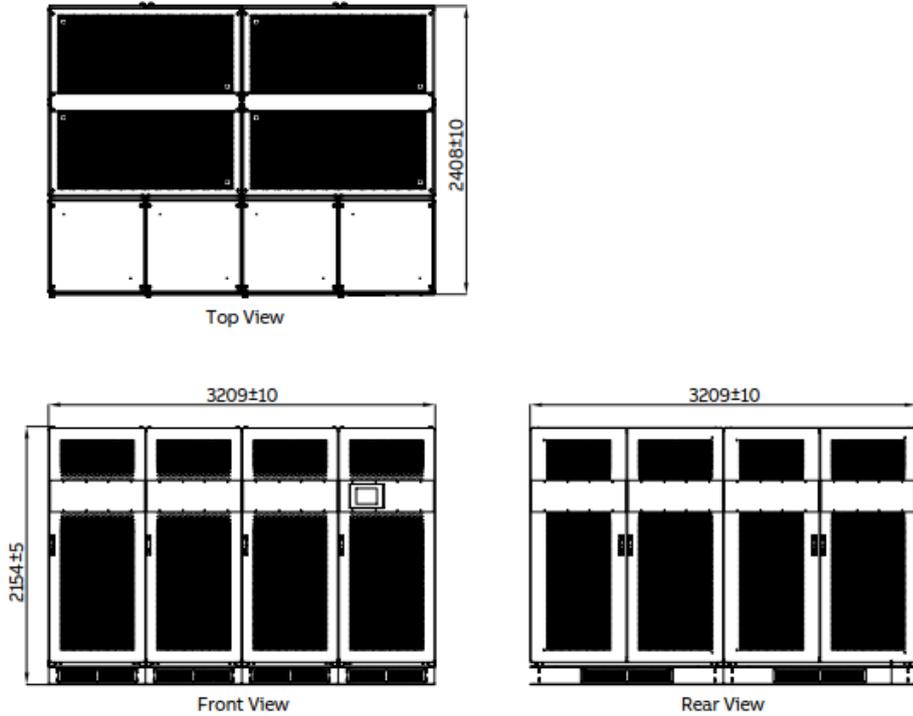

Clearance

The following clearances are required for all enclosures:

- Allow 200 mm (minimum above)
- Allow 1500 mm (recommended) clearance in front
- Allow 200 mm (minimum) clearance at the rear of Controller Enclosure for air flow. (Exception: The Transformer Enclosure can be placed back to back without any clearance.)
- No side clearance required
- Side clearance to the wall at the side where the cabinet outmost hinges of minimum 400 mm is recommended to allow the doors to open sufficiently. The doors must open 120° to allow normal cabinet access the PCS100 AVC-40 module replacement.

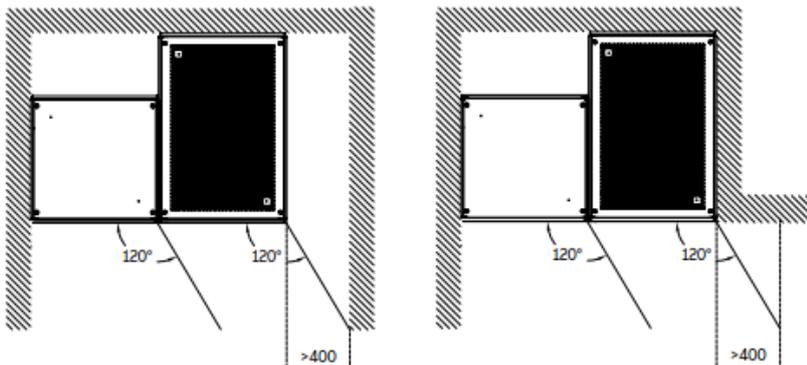

Weights

The following tables show the dimensions and weights of Controller Enclosure and Injection Transformer Enclosure in different frame sizes¹⁵.

| Frame Sizes | Controller Enclosure Dimensions (HxWxD) | Transformer Enclosure Dimensions (HxWxD) ¹⁶ | Controller Enclosure Weight | Transformer Enclosure Weight | Controller Enclosure Weight | Transformer Enclosure Weight |
|-------------|---|--|----------------------------------|------------------------------|-----------------------------|------------------------------|
| | mm | mm | kg | kg | kg | kg |
| | | | 220 V Models¹⁷ | | 400 and 480 V Models | |
| 1B | 2154x809x804 | | 1155 | | 1010 | |
| 2B | 2154x809x804 | 2154x809x804 | 581 | 1520 | 581 | 1235 |
| 3B | 2154x809x804 | 2154x809x1204 | 714 | 2380 | 714 | 1760 |
| 4B | 2154x1609x804 | 2154x1609x1204 | 1162 | 3880 | 1162 | 2885 |
| 5B | 2154x1609x804 | 2154x1609x1204 | 1294 | 3880 | 1294 | 2885 |
| 6B | 2154x1609x804 | 2154x1609x1204 | 1427 | 3880 | 1427 | 2885 |
| 8B | 2154x3209x804 | 2154x3209x1604 | | | 2324 | 7300 |
| 10B | 2154x3209x804 | 2154x3209x1604 | | | 2590 | 7300 |
| 12B | 2154x3209x804 | 2154x3209x1604 | | | 2856 | 7300 |

¹⁵ Allow ±10% tolerance for weights shown in the table

¹⁶ 1B frame size enclosure houses both the controller and transformer subassemblies

¹⁷ 220 V models do not have 8B, 10B and 12B frame sizes

Options

The following options are available for the PCS100 AVC-40 enclosures.

| Plus Code | Option Description | 1B | 2B | 3B | 4B, 5B, 6B | 8B, 10B, 12B | Note |
|-----------|--------------------------|----|----|----|------------|--------------|----------------------------|
| BB | Back-to-Back Layout Plan | | x | x | x | x | |
| SA | Side Aperture | x | x | x | x | x | |
| CD | Top Entry Cable Duct | x | x | | | | |
| RK | Roof Kit | x | x | x | x | x | |
| TE | Termination Enclosure | x | x | x | x | | |
| DMY | Dummy Enclosure | | x | x | x | | Back-to-Back layout only |
| TPx | Termination Palms | x | x | x | x | | X = I for IEC or N or NEMA |

Back-to-Back Layout (BB)

Most of the PCS100 AVC-40 models consist of a separate enclosure for the controller and the Injection Transformer. The standard layout is Side-

by-Side where the Controller Enclosure and Transformer Enclosure are lined up Side-by-Side.


For optional Back-to-Back layout (+BB plus code) the Transformer Enclosure is installed behind Controller Enclosure.

Side Aperture (SA)

Left and Right facing transformer enclosures are supplied with the complete side panel.

The enclosure can be supplied with an aperture pre-cut as pictured.

The side aperture allows for an easier side cable or bus bar connection to a maintenance bypass.

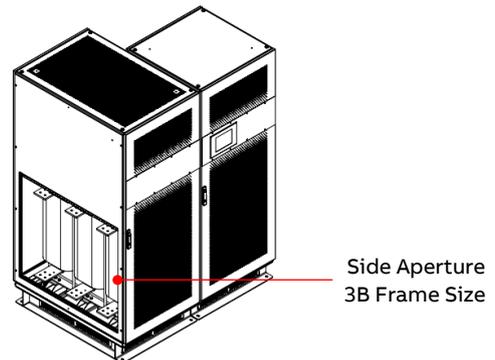


Top Entry Cable Duct (CD)

200 mm Top Entry Cable Duct for supply and load cables (or bus bars) can be accommodated for frame sizes 1B and 2B.

The Cable Duct has the same depth as the PCS100 AVC-40 enclosure and is mounted on the side of the transformer terminals.

The Cable Duct comes complete with a top gland plate¹⁸ and cable support.

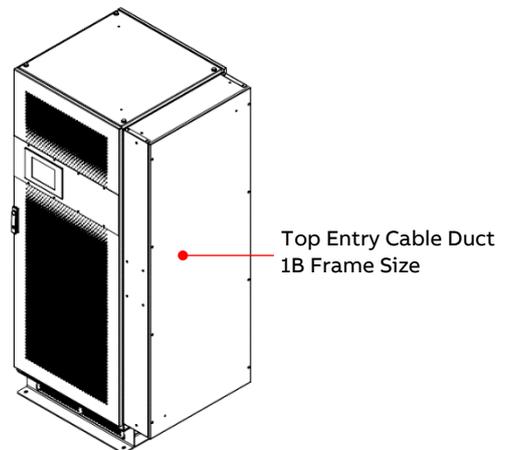

¹⁸ The Gland Plate is delivered as a blind plate without any holes

Roof Kit (RK)


Roof Kits are available where small amounts of liquid may fall onto the top of the enclosures.

The roof kit option increases the units' protection degree to IP21. These are only for indoor use.

There is a 200 mm clearance from the enclosure top to the roof kit to allow for ventilation of the transformer enclosure.

The kits will cover both the transformer and controller enclosures.

The roof kit is shipped separately and must be assembled on site

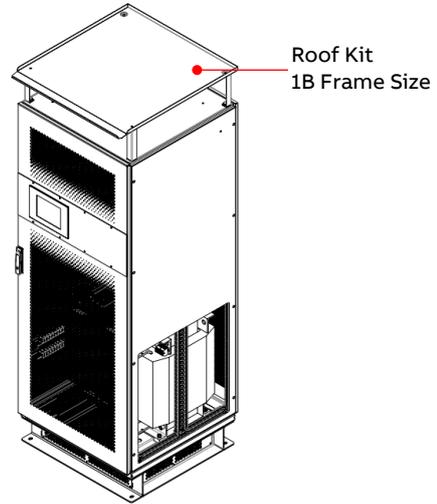


Termination Enclosure (TE)

The 400 mm Termination Enclosure option allows easier power connections or to match enclosure sizes with other equipment.

The Termination Enclosure has the same depth as the PCS100 AVC-40 enclosure and is mounted on the side of the transformer terminals.


The enclosure comes complete with a plinth and door access to enable top or bottom cable (or bus bar) connection.

The Termination Enclosure option includes cable support and gland plate.

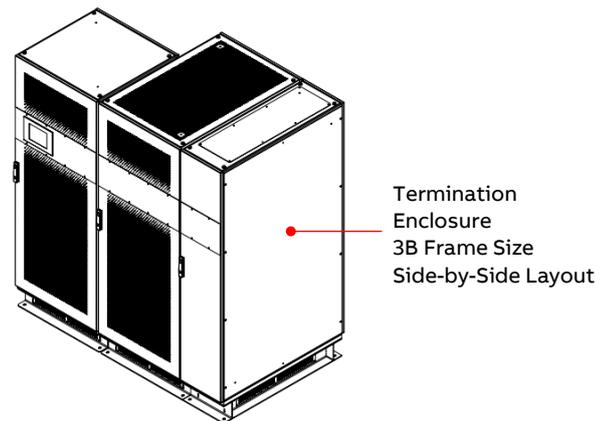

Dummy Enclosure (DMY)

400 mm Dummy enclosures are completely empty enclosures that can be ordered for cosmetic reasons, e.g. to fill a gap between other enclosures in a Back-to-Back layout.

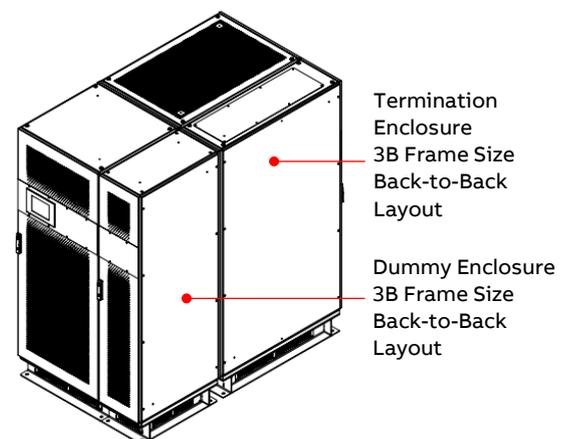

Termination Palms (TPx)

Standard termination palms on the PCS100 AVC-40 are horizontal bars.


Termination Palms option offers vertical bars with dimensions and hole positions according to IEC or NEMA standard for all of the termination positions.

See example of standard offering and TPx option on the images below.


Add appropriate standard letter instead of x in TPx for correct option code:

- IEC standard TPI
- NEMA standard TPN

Standard terminations

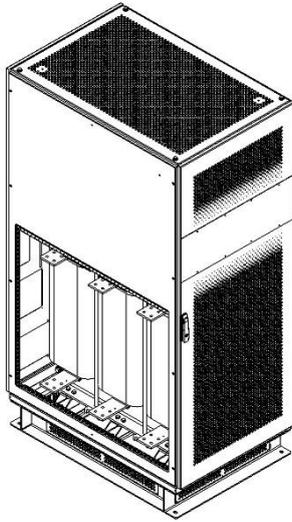

TPx Termination Palms

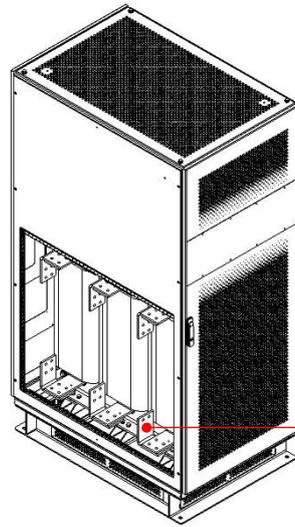


Optional
Termination Palm

User Interface

Graphic Display Module

The primary user interface for configuration of the PCS100 AVC-40 is via the Graphic Display Module (GDM). The GDM is a 10.1" touchscreen user-friendly intuitive interface. The integrated navigation screen gives easy accessibility to any information on the PCS100 AVC-40, shows the system status and provides access to the operating parameters and event history. The mimic diagram gives the users a clear view of the status of the system.

The supported languages are: English, French, Italian, Malaysian, Turkish, Russian, German, Vietnamese, Spanish, Simplified Chinese, Japanese, Traditional Chinese, Swedish, Indonesian, Portuguese, Arabic and Korean.

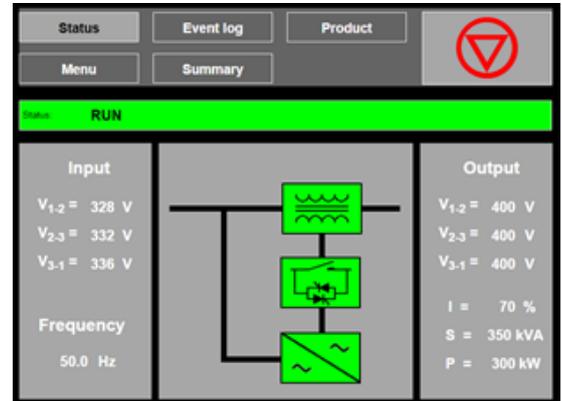

| Features | GDM |
|--|-------------------|
| Display resolution | 1024 × 600 pixels |
| Display size | 10.1" |
| Color graphic display | yes |
| Touch sensitive display | yes |
| Full descriptions of status and faults | yes |
| Local Start/Stop Reset Control | yes |
| Status Display | yes |
| Parameter adjustment | yes |
| Number of Event Log records stored | 10,000 |
| Event log can be downloaded to a PC | yes |
| Remote Web Pages | yes |
| Modbus TCP connection | yes |
| Multilanguage selection | yes |
| E-mail monitoring | yes |

Remote Monitoring

The GDM provides remote access for monitoring purpose. The following monitoring connections are available.

| Communication Type | Description | Connection |
|----------------------|-----------------------------------|---------------|
| Remote Web Pages | HTML server - Ethernet connection | Standard RJ45 |
| Monitoring system | Modbus TCP | Standard RJ45 |
| Remote notifications | E-mail | Standard RJ45 |

Remote Web Pages

The Remote Web Pages are a set of web pages that are similar in format to the standard GDM and can be viewed with any standard web browser on a device connected to the same network. Through this interface the users can remotely access the status and operating parameters. Viewing and downloading of the event history and service logs is also available. The Remote Web Pages enable users to select different languages for each remote client.


Modbus TCP

A Modbus TCP connection is also provided via the Ethernet port of the GDM user interface. Read Only access is available to operating parameters such as voltages, currents and power levels.

E-mail

The PCS100 AVC-40 is configurable for sending e-mail notifications in case of power quality events or systems internal events such as faults and warnings.

Automatic sending of the service logs via e-mail to ABB Service can also be enabled.

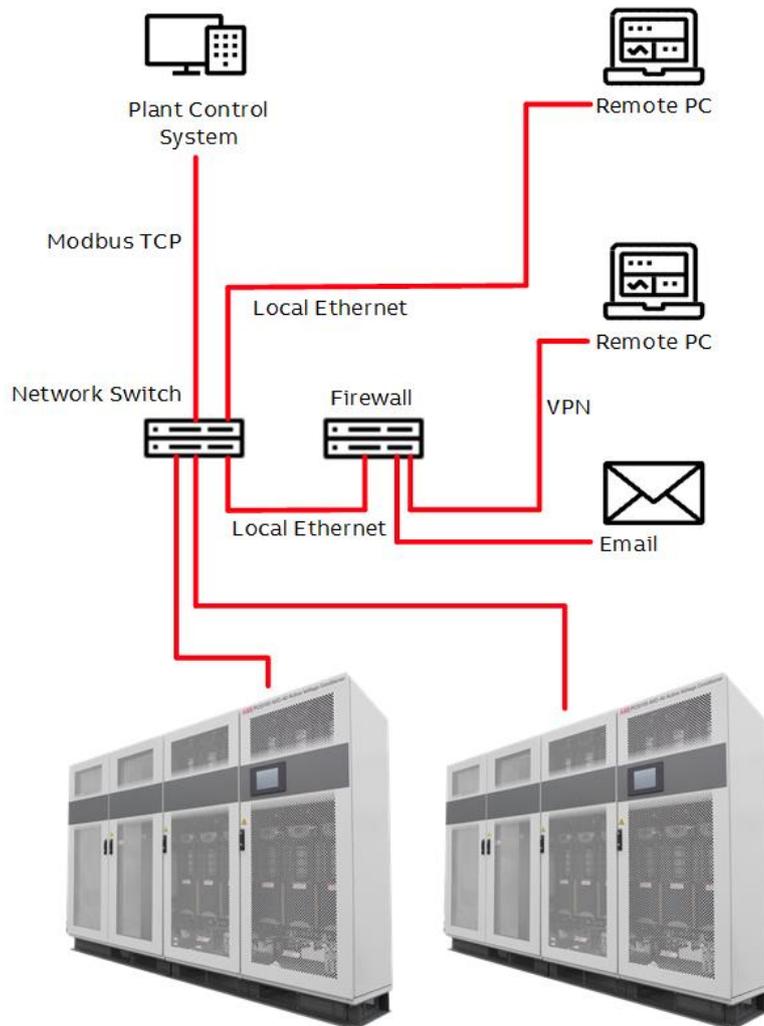

User Connections


Power Connections

The PCS100 AVC-40 utility supply (input) and load (output) connections are connected directly to the Injection Transformer terminals in the Transformer Enclosure.

The following table defines connection sides.

| Transformer terminals | Connections |
|-----------------------|------------------------|
| Top terminals | Utility Supply (Input) |
| Bottom terminals | Load (Output) |

The figure on the right shows the power connection location on a 3B frame size with L (left) termination side and +SA Side Aperture option.

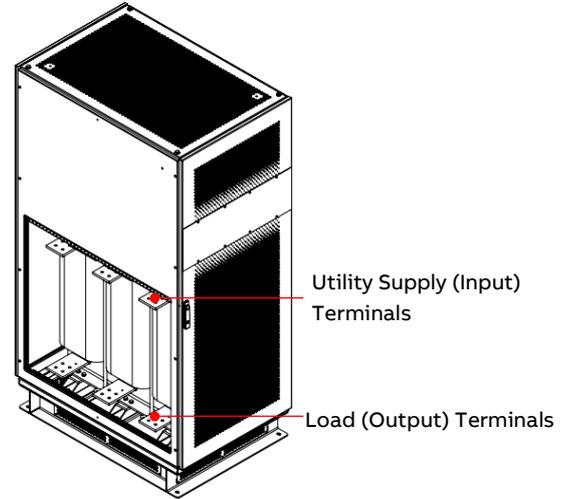


Control Connections

The PCS100 AVC-40 includes control connections for local control or monitoring of the system.

Control connection terminals are located on the

Auxiliary Master Module in the Master Controller Enclosure.

| Control Connection | Description |
|---------------------------|--|
| 3 Relay Outputs | PCS100 AVC-40 status information 250 VAC/30 VDC, 1 A |
| 1 Isolated Thermal Switch | Transformer over temperature information 24 VDC/24 VAC, 1 A Normally closed (NC) contact |
| 2 Digital Inputs | PCS100 AVC-40 Remote control Start/Stop/Inhibit Dry contacts |

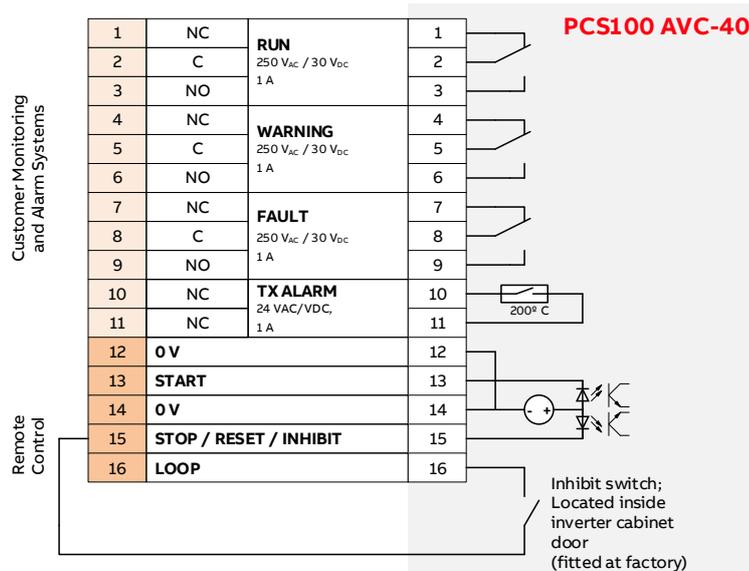

Installation Requirements

Input Circuit Protection

The PCS100 AVC-40 relies upon upstream protection for current overload and short circuit protection. Upstream protection should be provided by a circuit breaker.

Overload protection must not be set greater than the PCS100 AVC-40 rated load current. Short circuit and arc fault calculations should include allowance for the additional PCS100 AVC-40 impedance (typically < 2.5%). Circuit breakers should be set to trip without any delay on short circuit or arc fault currents.

Coarse ground fault detection is recommended for high current systems where it may be difficult to assure ground or arc fault currents of sufficient magnitude to instantaneously trip the breaker.

The PCS100 AVC-40 unit is designed to withstand significant short circuit current. Typical short circuit withstand ratings are summarized in the model tables and also in the table below. The smaller systems in the table rely on fault current limiting protection from upstream circuit breakers or fuses provided by the customer.

For 400/480 V models 1B frame size current limiting molded case circuit breakers (MCCB) are required to provide very fast clearing of short circuit currents. ABB T5 series or equivalent are suitable.

| Frame Size | | 1B | 2B | 3B | 4B | 5B | 6B | 8B | 10B | 12B |
|--------------|-----|--------------------|--------------------|--------------------|------------------|------|------|------|------|------|
| Rated Power | kVA | 300 | 600 | 900 | 1200 | 1500 | 1800 | 2400 | 3000 | 3600 |
| 220 V models | kA | 31.5 ¹⁹ | 40 | 50 | 80 | 100 | 100 | N/A | N/A | N/A |
| 400 V models | kA | 15 ²⁰ | 31.5 ¹⁹ | 31.5 ¹⁹ | 40 | 50 | 63 | 65 | 65 | 65 |
| 480 V model | kA | 20 ²⁰ | 25 ¹⁹ | 25 ¹⁹ | 40 ¹⁹ | 40 | 50 | 65 | 65 | 65 |

The PCS100 AVC-40 is rated to carry short duration fault currents to 2000% for 200 ms, and the upstream protection for small systems must be sized within this capability.

If required the ABB factory can provide assistance with sizing appropriate protection. The PCS100 AVC-40 can sustain the fault currents listed above without damage and can be returned immediately to service following the fault. Where higher fault currents occur, service may be required following a downstream fault

Maintenance Bypass

ABB recommends that a maintenance bypass (not supplied with the PCS100 AVC-40) is fitted. The maintenance bypass allows maintenance to be performed on the PCS100 AVC-40 without disruption to the load.

ABB requires the input and output breakers of a maintenance bypass to be lockable for an ABB service personnel to carry out any work on the PCS100 AVC-40. Please note that ABB LV breakers do not provide this as standard but as an option.

Floor Requirements

All enclosures must be installed on a horizontal fireproof surface.

Do not exceed $\pm 0.2^\circ$ change in slope between adjacent enclosures.

Do not exceed ± 5 mm in elevation between adjacent enclosures.

Electromagnetic Compatibility (EMC)

The PCS100 AVC-40 is designed for commercial and industrial applications. It is not suitable for connection to a low-voltage utility that is supplying residences unless additional measures are taken.

¹⁹ Needs to be protected by upstream protection

²⁰ Needs to be protected MCCB (ABB T5 or equivalent)

Location

The PCS100 AVC-40 is designed for location in a restricted access location only.

The PCS100 AVC-40 is designed for connection by fixed wiring.

The PCS100 AVC-40 system should be located in a clean electrical room with a controlled environment temperature and humidity according to the requirements under the Technical Specification section.

Power System

The PCS100 AVC-40 is designed for TN-S power system where the upstream transformer provides neutral the load may require. Consult the factory for use in other earthing system.

Harmonics

The PCS100 AVC-40 is designed to tolerate disturbances such as voltage and current harmonics in the load or supply. Excessive distortion can lead to the stressing of components leading to reduction in the lifetime of the rectifier and inverter modules.

ABB recommends the harmonic contents on the input and the output of the system to meet IEC 61000-2-4 Class 2, THD_v up to 8%.

Contact the factory for THD_v > 8% as the lifetime of components may be affected.

Downstream Capacitor Banks

A care must be taken when installing the PCS100 AVC-40 with a capacitor bank downstream of the system. ABB recommends the capacitor bank to be installed upstream of the PCS100 AVC-40. Contact ABB for more information.

Service and Technical Support

ABB Power Conditioning provide global service and support of installation and commissioning of PCS100 products

Comprehensive global services portfolio

ABB services span the entire product ownership life cycle:

- Pre-purchase engineering
- Installation and commissioning
- Technical support
- Training
- Preventive and corrective maintenance and maintenance spare parts kits
- Retrofit and refurbishment
- Globally available, supported by regional service hubs and operating in more than 100 countries
- Spare part availability and stocking
- On-site repairs
- 24 x 365 local support line

Custom tailored service contracts

- 24 x 365 local support line
- ABB services can be packaged into a custom service contract
- Tailored to the specific needs of each customer
- Contracts can be made at any stage of ABB product ownership

Service contracts provide customers with improved cost controls, increased operational efficiency, lower capital expenditures, and extend ABB product life time.

Life cycle management

ABB's life cycle management model maximizes the value of the equipment and maintenance investment by maintaining high availability, eliminating unplanned repair costs and extending the lifetime of the system. Life cycle management includes:

- Spare parts and expertise throughout the life cycle
- Efficient product support and maintenance for improved reliability
- Functionality upgrades to the initial product

Training

- Product training includes installation, commissioning, and maintenance
- Training either at ABB Universities or at a customer site
- Training can be included in an ABB services contract

Engineering and technical support

ABB's engineering team provides the necessary electrical, protective and monitoring equipment, delivering a high level of energy continuity and superior power quality in a safe and cost-effective system. The PCS100 is available in several capacities, depending on the scope of application.

- Pre-purchase engineering to help select and integrate ABB PCS100 products
- Customer assistance in sizing and modeling of systems
- Other life cycle engineering and technical support is available by phone, email, or on-site visits, or as agreed in an ABB services contract
- Redundant internal bypass design increases reliability and availability and is part of a proven family of global ABB products
- Scalable building block design

Additional documents

| Document Number | Document Name |
|-----------------|--|
| 2UCD074000E001 | PCS100 AVC-40 User Manual |
| 2UCD074000E003 | PCS100 AVC-40 Installation Checklist |
| 2UCD074000E004 | PCS100 AVC-40 Commissioning Checklist |
| 2UCD070000E020 | PCS100 AVC Detailed Performance Curves |
| 2UCD070000E025 | AVC in TT Power Systems AN |
| 2UCD200000E007 | PCS100 Environment Specification |



Notes



ABB Limited

Power Conditioning Products

Email: nz-powerconditioningservice@abb.com

Visit: www.abb.com/ups